




CONSTRUCTION BOARD OF APPEALS
CITY DEVELOPMENT DEPARTMENT
BUILDING & DEVELOPMENT PERMITTING DIVISION

Michael Travis Comanche Contractors
(281) 541-7182
mtravis@comanchecontractors.com
City of El Paso, Texas
222 S. Campbell St
El Paso, TX 79901-1196
915-541-4557

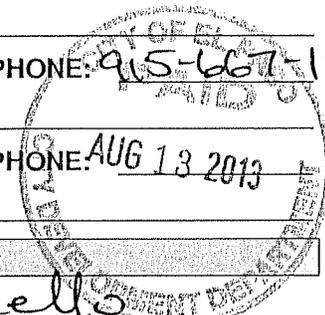

1. CONTACT INFORMATION

PROPERTY OWNER(S): EPT Hand Development
ADDRESS: 444 Executive Dr. ZIP CODE: 79902 PHONE: 915-667-180
REPRESENTATIVE(S): David Bogus
ADDRESS: _____ ZIP CODE: _____ PHONE: _____
E-MAIL ADDRESS: _____ FAX: _____

2. PARCEL INFORMATION

PROPERTY IDENTIFICATION NUMBER: Retreat at Monticello
LEGAL DESCRIPTION: Multi-Family Residential
STREET ADDRESS OR LOCATION: 140 W. Castellano REP. DISTRICT: _____
ACREAGE: _____ ZONING: _____ LAND USE: _____ YEAR BUILT: _____

3. SPECIAL EXCEPTION OR VARIANCE REQUEST


TYPE: Electrical
EXPLANATION OF REQUEST: For an interpretation of EP electrical code
 RESIDENTIAL (\$540.00 APPLICATION FEE) COMMERCIAL (\$540.00 APPLICATION FEE)

4. NOTE TO APPLICANT – see additional notes on Page 2

The applicant or representative must be present at the scheduled hearing to answer any questions or present required information to the Board. It is the Board's policy to postpone the case when the applicant or representative fails to appear at the scheduled hearing; however, the Board is not required to postpone the application and may postpone, approve or disapprove the application with or without the applicant or representative's presence. If the applicant or representative is unable to attend the hearing, a postponement may be requested prior to the meeting. Per Section 2.16.060 F of the El Paso City Code, the Board will not consider an appeal or application that is the same or very similar to one that has been denied, for a period of one year.

5. ADDITIONAL INFORMATION

I attest that this application is complete and accurate to the best of my knowledge and that the statements and exhibits submitted with this application are true and correct. I understand that any inaccurate or incomplete information provided on this application may delay the processing and scheduling of this request.

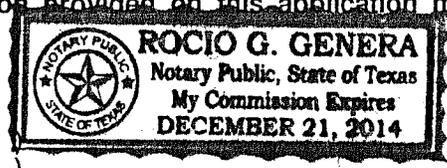

THE STATE OF TEXAS)
COUNTY OF EL PASO)

[Signature]
SIGNATURE OF PROPERTY OWNER
Contractor

This instrument is acknowledged before me on this 13th day of August, 2013.

[Signature]
Signature of State of Texas Notary Public

****OFFICE USE ONLY****
CASE NUMBER: BCN12-0009 APPEAL FILE DATE: ___/___/___ RECEIVED DATE: 8/13/13
CBA REVIEW DATE: ___/___/___ (5:30 PM, CITY HALL – COUNCIL CHAMBERS 300 N. CAMPBELL)
ACCEPTED BY: Rocio Genera APPLICATION FEE: \$540.00
Rev 3/22/2013



City of El Paso
222 South Campbell St.
El Paso, Texas 79901

Dear Mr. Vega,

Comanche contractors hereby request at your earliest convenience a variance meeting for the El Paso electrical code addendum 18.16.160 section 334.10 that modifies the 2008 NEC code. The "Addendum" requires the use of the metallic shielded wire in the construction of a project four story or higher on wood framed multi-family residential project. We offer no excuse to our ignorance of the addendum except for fact that the code compliance sheet only states "2008 National Electrical Code" and there was no mention of "with addendums"

We offer for your consideration in our request for a variance to the addendum the City of Houston, Dallas, Fort Worth, San Antonio, Austin, and Amarillo building electrical codes which allow the use of romex wire in the construction of multi-family residential projects above three story wood framed construction of multi-family residential projects per the 2008 national electric codes with no exceptions for four story construction.

Please let us know when variance can be arrange. Thank you. For your consideration,

Very truly yours

Alan T. Cooke
Sr. Project Manager
Comanche Contractors, L.P.

COMANCHE CONTRACTORS, L.P.
www.comanchecontractors.com
10450 Westoffice Dr.
Houston, TX 77042
Ph. (713)862.4545 · Fax (713)862-8407



City of El Paso
222 South Campbell St.
El Paso, Texas 79901

Dear Mr. Vega,


We are sending to you this letter in reference to your denial of allowing us to install Romex wire in a four (4) story, multi-family residential building, per NEC 2008 guide lines.

We would like to request a hearing before the construction board to get their interpretation on wiring the first three floors with Romex and the 4th with MC Cable.

Regards,

Michael Travis
Project Manager
Comanche Contractors, L.P.

COMANCHE CONTRACTORS, L.P.
www.comanchecontractors.com
10450 Westoffice Dr.
Houston, TX 77042
Ph. (713)862.4545 · Fax (713)862-8407



August 13, 2013

Ms. Rocio Genera
Construction Board of Appeals


Dear Ms. Genera:

Per the NEC Section 334.10(2), NMC cable is specifically allowed in multifamily dwellings of Type V construction. Per the El Paso local electrical amendments, however, NMC cable is only allowed on structures three stories in height or less.

The Retreat at Montecillo is a four (4) floor Type V-A multifamily building. It is fully sprinklered (NFPA 13R system) with one (1) hour rated walls. The building is currently under construction, and NMC (Romex) wiring has already been installed in Floors one (1) to three (3). We are requesting an interpretation of the El Paso electrical amendments to allow NMC cable for up to three (3) floors, and the installation of MC cable on the fourth floor.

Sincerely,

Sujaya Regmi, P.E.
Senior Project Manager
Texas Licensed Professional # 102737

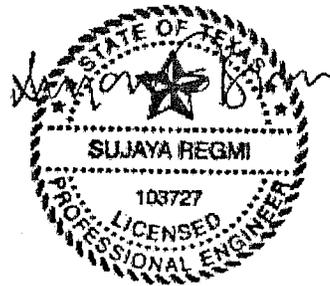

08/13/2013

T:\10170410016 Retreat at Montecillo\Correspondence\Out\08.12.13 Genera.doc/dn

BURY+PARTNERS
221 West Sixth Street, Suite 600
Austin, TX 78701

tel (512) 328-0011
fax (512) 328-0325

www.burypartners.com
IBPE No. F-1048

Austin • Dallas • Houston • San Antonio • Temple, Texas

Dedicated to Outstanding Customer Service for a Better Community

SERVICE SOLUTIONS SUCCESS

City Development Department
August 13, 2013



Alan T. Cooke
Sr. Project Manager
Comanche Contractors, L.P.

Ref: Case No: BCNN12-00009
Address: Retreat C Montecillo – 140 W. Castellano

Mr. Cooke

This will constitute official response to your letter sent on August 12, 2013 requesting a variance to Title 18.16.160, enacted through Ordinance 017417, adopted on September 21, 2010 and effective as of June 1, 2011, which modifies Section 334.10 of the 2008 National Electrical Code as follows:

Type NM, NMC and NMS cable shall be permitted to be used in the following:

- 1. One and two-story family dwellings.*
- 2. Multifamily dwellings not exceeding three floors above grade.*

This request is therefore denied, this office cannot grant variances on adopted ordinance enacted by City Council.

Any request for Code interpretation can be directed to the Construction Board of Appeals through an application submitted to the City Clerk's office along with the application fee of \$540.00. Please feel free to contact me if you have any questions.

Sincerely,


Juan Estala
Chief Plans Examiner
EstalaJO@elpasotexas.gov
(915) 541-4795

Mayor
Oscar Leeser

City Council

District 1
Ann Morgan Lilly

District 2
Larry Romero

District 3
Enma Acosta

District 4
Carl Robinson

District 5
Dr. Michel R. Nee

District 6
Eddie Holguin Jr.

District 7
Lily Limon

District 8
Dorrey C. Noland

City Manager
Joyce A. Wilson

City Development Department
222 S. Campbell | P.O. Box 1890 | El Paso, Texas 79950-1890 | (915) 541-4622

EL PASO. IT'S ALL GOOD.



Alan T. "Bink" Cooke
acooke@comanchecontractors.com

Comanche Contractors, L.P.
General Contractors
10450 Westoffice Dr.
Houston, Texas 77042
713-862-4545 Phone
713-862-8407 Fax
www.comanchecontractors.com



Michael Travis
mtravis@comanchecontractors.com
281.541.7182


Comanche Contractors, L.P.
General Contractors
10450 Westoffice Dr.
Houston, Texas 77042
713-862-4545 Phone
713-862-8407 Fax
www.comanchecontractors.com



DAVID BOGAS
DIRECTOR OF DEVELOPMENT

T: (915) 838-8100 | C: (915) 667-1800 | F: (915) 838-8200
dbogas@eptcommunities.com

444 EXECUTIVE CENTER BLVD., STE. 238 • EL PASO, TX 79902

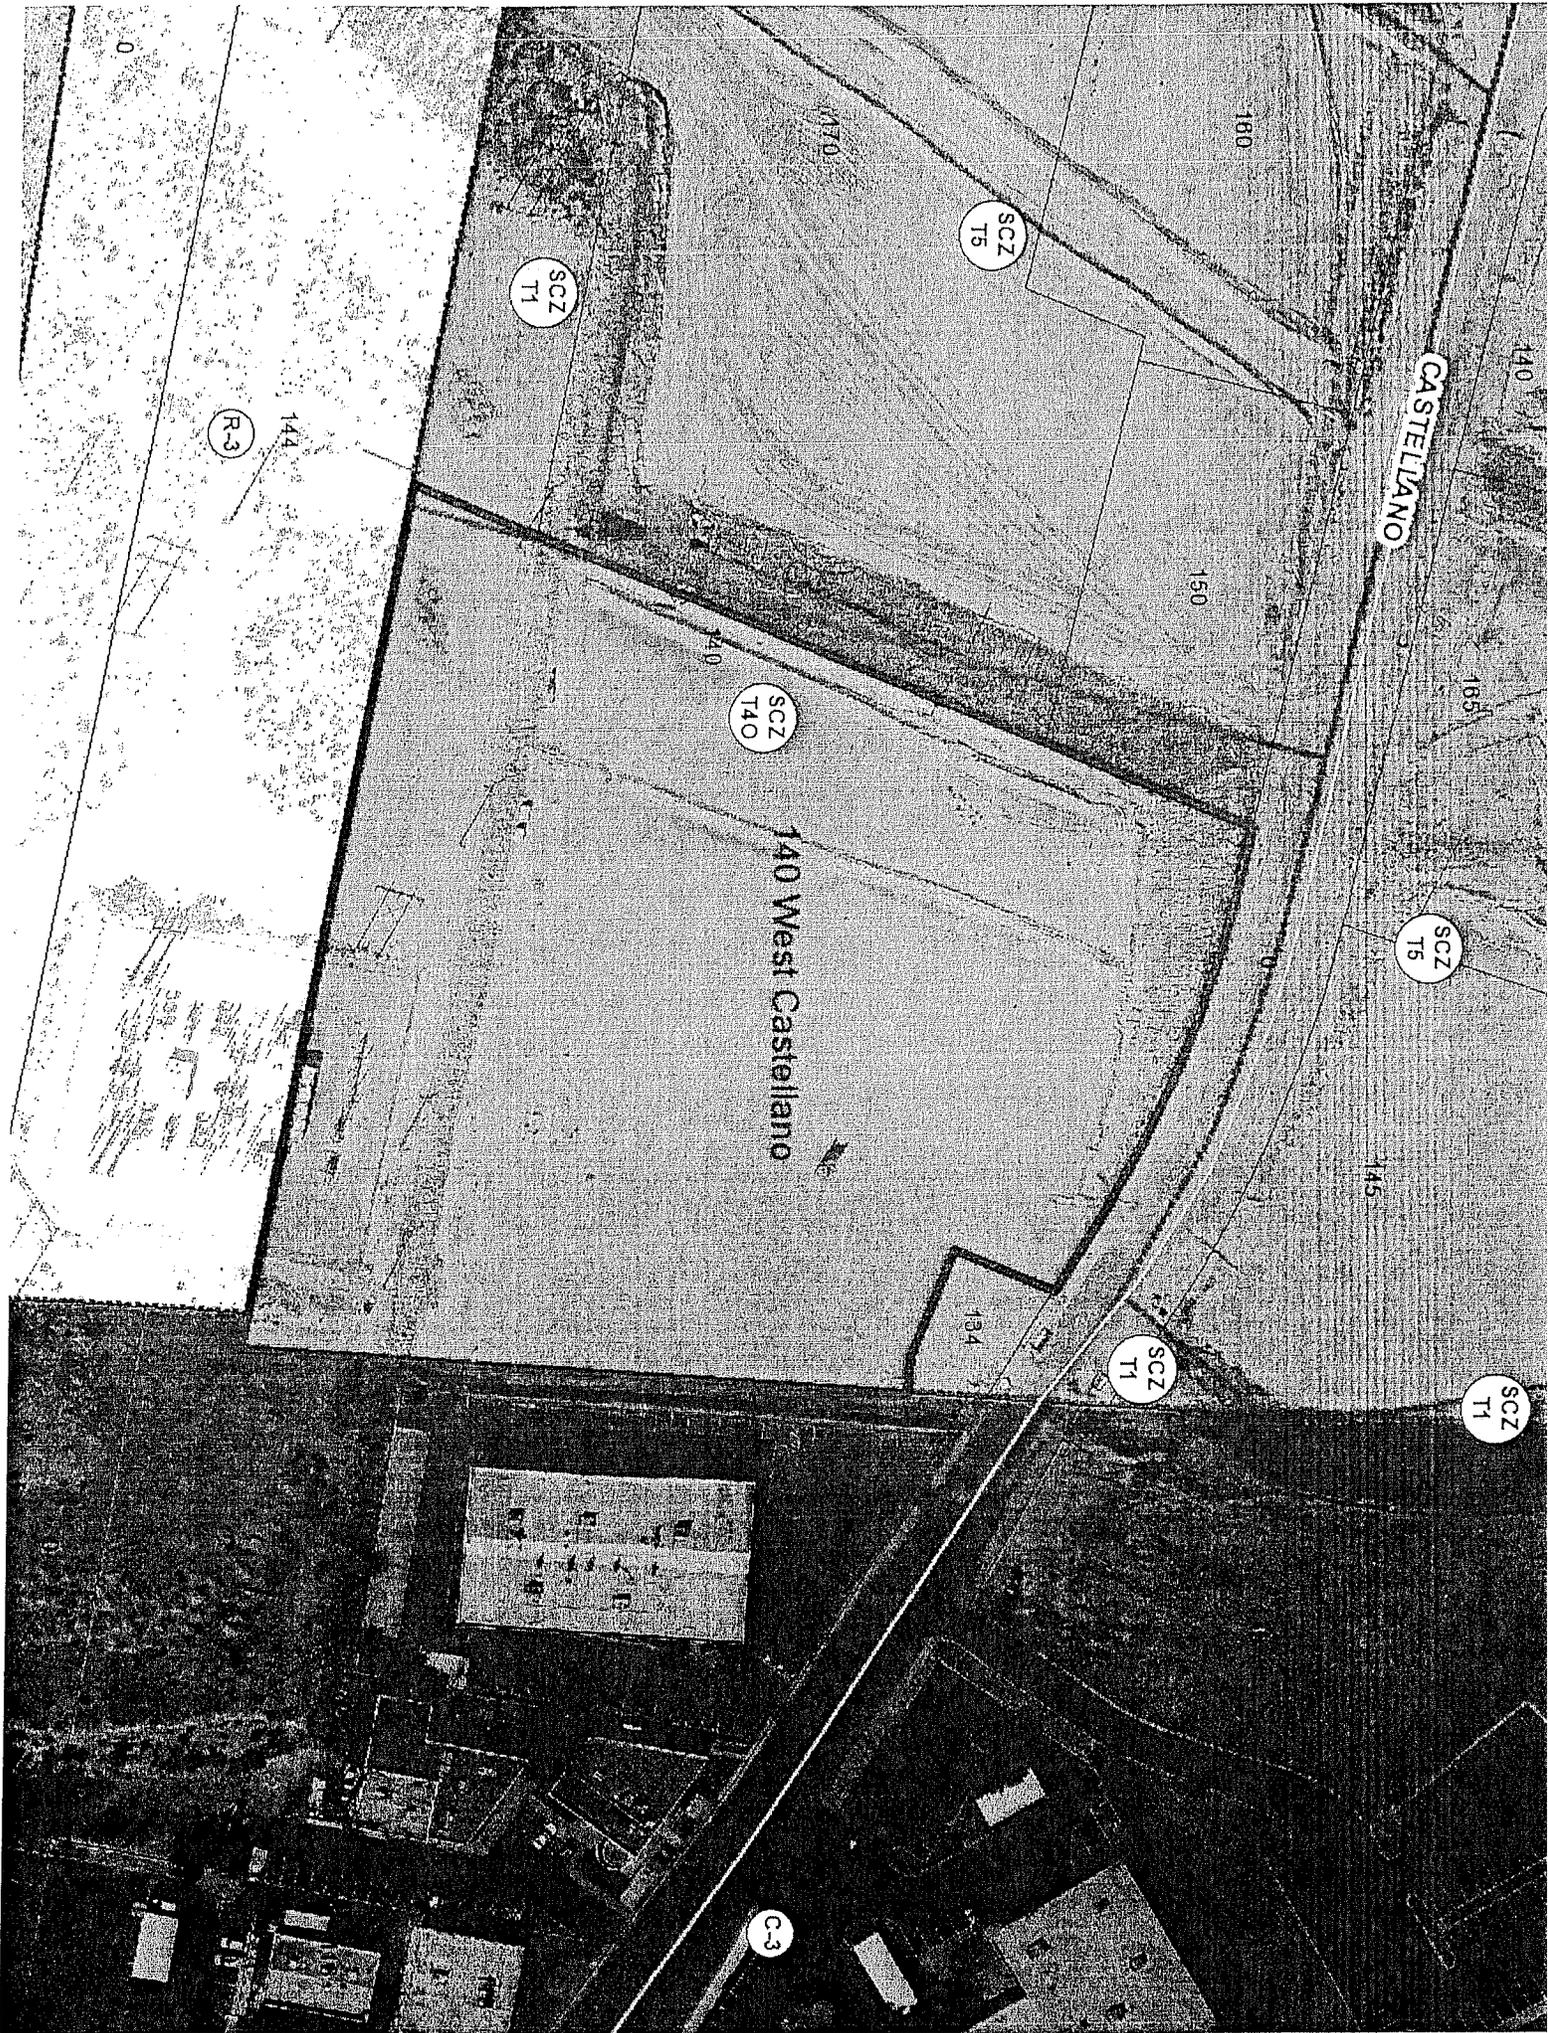

NFPA 70 National Electrical Code, 2008 Edition, Section 250.8 Connection of Grounding and Bonding Equipment, (B) Methods Not Permitted, is hereby amended to read as follows:

250.8 Connection of Grounding and Bonding Equipment, (B) Methods Not Permitted. (1) Connection devices or fittings that depend solely on solder shall not be used. (2) Sheet metal screws shall not be used to connect grounding conductors or connection devices to enclosures.
(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.150 - Section 310.2 Conductors (B) Conductor Material, amended.

NFPA 70 National Electrical Code, 2008 Edition, Section 310.2 Conductors, (B) Conductor Material, is hereby amended to read as follows:

310.2 Conductors, (B) Conductor Material. Conductors in this article shall be of aluminum, copper clad aluminum or copper unless otherwise specified. Aluminum or copper-clad aluminum conductors shall not be smaller than No. 2 AWG, except a ground conductor which is part of an approved cable assembly shall be not smaller than No. 6 AWG.
(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

~~18.16.160 - Section 334.10 Uses Permitted (1), (2), (3), (4), amended.~~

NFPA 70 National Electrical Code, 2008 Edition, Section 334.10 Uses Permitted, items (1), (2), (3) and (4) are amended to read as follows:

334.10 Uses Permitted Type NM, Type NMC, and Type NMS cables shall be permitted to be used in the following:

- (1) One- and two-family dwellings.
- (2) Multifamily dwellings not exceeding three floors above grade.

(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.170 - Section 358.10 Uses Permitted (B) Corrosion Protection, amended.

NFPA 70 National Electrical Code, 2008 Edition, Section 358.10 Uses Permitted, (B) Corrosion Protection, is hereby amended to read as follows:

358.10 Uses Permitted, (B) Corrosion Protection. Ferrous or nonferrous EMT, elbows, couplings, and fittings shall be permitted to be installed in concrete. EMT shall not be used in direct contact with the earth or in areas subject to severe corrosive influence.
(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.180 - Article 382 Nonmetallic Extensions, deleted.

NFPA 70 National Electrical Code, 2008 Edition, Article 382 Nonmetallic Extensions is hereby deleted in its entirety.

(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.190 - Article 394 Concealed Knob-and-Tube Wiring, deleted.

NFPA 70 National Electrical Code, 2008 Edition, Article 394, concealed Knob-and-Tube Wiring, is hereby deleted in its entirety.

(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.200 - Article 398 Open Wiring on Insulators, deleted.

NFPA 70 National Electrical Code, 2008 Edition, Article 398, Open Wiring on Insulators is hereby deleted in its entirety.

(Ord. No. 17417, § B, 9-21-2010, eff. 6-1-2011)

18.16.210 - Section 404.10 Mounting of Snap Switches, (A) Surface-Type, deleted.

CODE SUMMARY

CODES IN EFFECT FOR EL PASO, TEXAS

ADOPTED EDITION

2009 INTERNATIONAL BUILDING CODE

LOCAL ORDINANCE(S) 017413 AND 017414 AND TITLE 18

2009 INTERNATIONAL MECHANICAL CODE

2009 INTERNATIONAL PLUMBING CODE

2008 NATIONAL ELECTRICAL CODE

2009 INTERNATIONAL FIRE CODE

(S)

FAIR HOUSING ACT DESIGN GUIDE (FHADG), AMERICANS WITH DISABILITIES ACT,
TEXAS ACCESSIBILITY STANDARDS (TAS), ORD. 17413 & 17414

CHAPTER 11 OF 2009 INTERNATIONAL BUILDING CODE

2009 INTERNATIONAL ENERGY CONSERVATION CODE

POTENTIAL

LOCATED ON FIRST LEVEL

THE FIRST LEVEL

SMART CODE - T4-0

CLASSIFICATION

SEPARATED USES (RESID./ASSEM.)

R-2

A-3

A-3

CONSTRUCTION TYPE

TYPE V-A

TYPE V-A

TYPE V-A

TYPE V-A

SYSTEMS

SYSTEM MUST MEET ALL REQUIREMENTS OF NFPA 13R SPRINKLER SYSTEMS.

NFPA 13R

NFPA 13R

NFPA 13R



PWVX.GuidelInfo Nonmetallic-sheathed Cable

[View Listings](#)

[Page Bottom](#)

Nonmetallic-sheathed Cable

Guide Information for Electrical Equipment for Use in Ordinary Locations

USE

This category covers Types NM-B and NMC-B nonmetallic-sheathed cable, rated 600 V, intended for use in accordance with Article 334 of ANSI/NFPA 70, "National Electrical Code" (NEC), and certified in copper sizes 14 to 2 AWG inclusive and aluminum or copper-clad aluminum sizes 12 to 2 AWG inclusive.

This cable contains conductors rated 90°C; however, the ampacities of the cable are those of 60°C conductors as specified in Article 334 and Table 310.16 of the NEC.

PRODUCT MARKINGS

Cable with copper-clad aluminum conductors is surface marked "AL (CU-CLAD)" or "Cu-clad Al," and cable with aluminum conductors is surface marked "AL."

Wire and cable employing compact-stranded copper conductors is so identified directly following the conductor size, wherever it appears (surface, tag, carton or reel), by "compact copper." The abbreviations "CMPCT" and "CU" may be used for compact and copper, respectively.

Tags, reels and cartons for products employing compact-stranded copper conductors have the marking: "Terminate with connectors identified for use with compact-stranded copper conductors."

Cable suitable for use in cable trays is appropriately marked. Cable marked for cable tray use may also have a supplementary sunlight resistant marking.

Cable that complies with the Limited Smoke Test requirements specified in [UL 1685](#), "Vertical-Tray Fire-Propagation and Smoke-Release Test for Electrical and Optical-Fiber Cables," is surface marked "ST1."

PRODUCT IDENTITY

One of the following product identities may appear on the product:

Nonmetallic-sheathed Aluminum Cable (for nonmetallic-sheathed cable that contains aluminum conductors)

Nonmetallic-sheathed Cable (for nonmetallic-sheathed cable that contains copper or copper-clad aluminum conductors)

ADDITIONAL INFORMATION

For additional information, see Electrical Equipment for Use in Ordinary Locations ([AALZ](#)).

REQUIREMENTS

The basic standard used to investigate products in this category is [ANSI/UL 719](#), "Nonmetallic-Sheathed Cables."

UL MARK

The UL symbol on the product and the Certification Mark of UL on the attached tag, coil, reel, or on the smallest unit container in which the product is packaged is the only method provided by UL to identify products manufactured under its Certification and Follow-Up Service. The [Certification Mark](#) for these products includes the UL symbol, the words "CERTIFIED" and "SAFETY," the geographic identifier(s), and a file number.

Alternate UL Mark

The UL symbol on the product and the Listing Mark of UL on the attached tag, coil, reel or smallest unit container in which the product is packaged is the only method provided by UL to identify these products manufactured under its Listing and Follow-Up Service. The Listing Mark for these products includes the UL symbol (as illustrated in the Introduction of this Directory) together with the word "LISTED," a control number, and the product name as appropriate: Nonmetallic-sheathed cable that contains copper or copper-clad aluminum conductors has the product name "Nonmetallic-sheathed Cable"; nonmetallic-sheathed cable that contains aluminum conductors has the product name "Nonmetallic-sheathed Aluminum Cable."

UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. UL shall not incur any obligation or liability for any loss, expense or damages, including

incidental or consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Guide Information.

Last Updated on 2013-05-16

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2013 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2013 UL LLC".

Username


Password

[Register Now](#)

[Forgot Password?](#)



Keyword Search



Southwire Product Catalog Romex® SIMpull® Type NM-B

Romex® SIMpull® Type NM-B

Residential

Commercial

Mining

Industrial

Transmission

Substation

Distribution


Renewables

OEM

SCR Technologies

Canada

América Latina

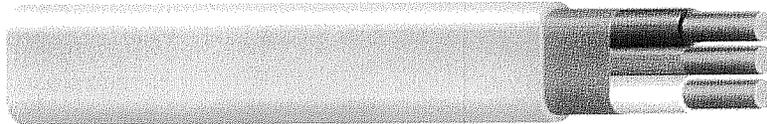

- Non-metallic Sheathed Cable
- 600 Volt
- Copper Conductors
- Color-Coded Jacket SIM Jacket™
- Construction Designed for Easier Pulling
- Four Conductor Available With Two Neutrals
- Pulls Faster
- Strips Easier
- Reduced Burn-Thru
- Tear Resistant

APPLICATIONS

Southwire's Romex® SIMpull® Type NM-B (non-metallic sheathed cable) may be used for both exposed and concealed work in normally dry locations at temperatures not to exceed 90°C (with ampacity limited to that for 60°C conductors) as specified in the National Electrical Code¹ NM-B cable is primarily used in residential wiring as branch circuits for outlets, switches, and other loads. NM-B cable may be run in air voids of masonry block or tile walls where such walls are not subject to excessive moisture or dampness. Voltage rating for NM-B cable is 600 volts.



Product Specifications



MADE IN THE USA

RELATED PRODUCTS

- Annunciator (Bell) Wire
- Bare Copper
- CL 1251/AWM 3173
- Fire Alarm Cable (FAS)
- HLX01-POS/SPOS
- HLX01XXH
- LVT
- RHH/RHW/USE
- Romex® SIMpull® Type NMD90
- SEU/SE/USE
- SIS
- TEW/AWM 1015/1019/1020/12-MTW
- TFN/TFN/TEWN
- THN/THWN/TWN7
- TR64/AWM 1007
- UF-B
- XHBW

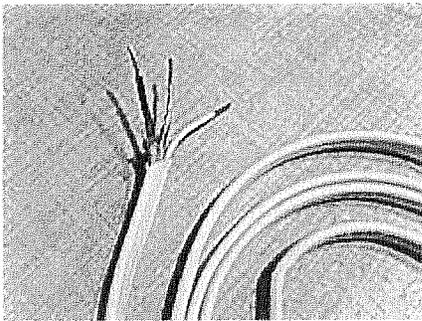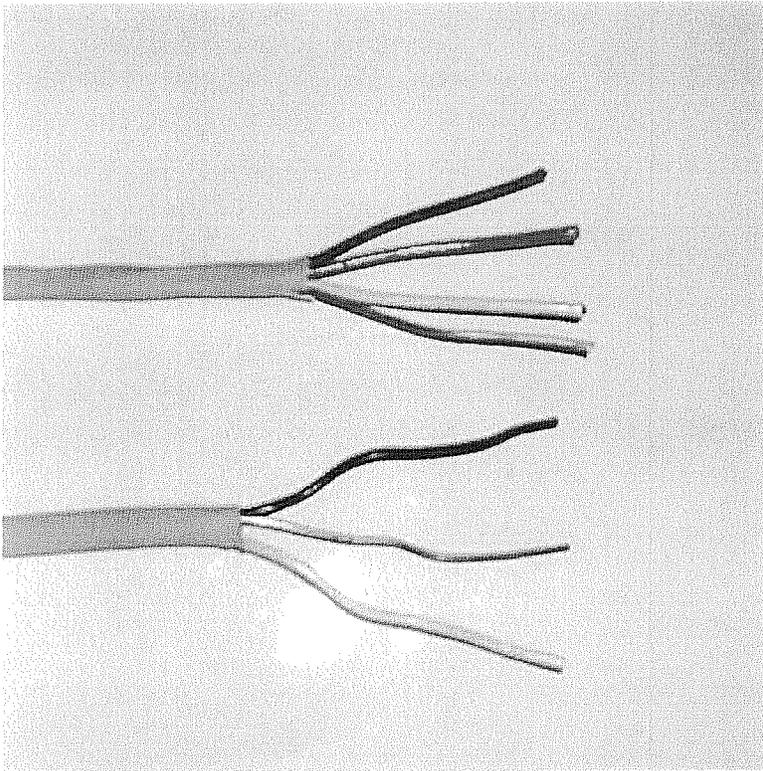



PJAZ.GuidelInfo Metal-clad Cable

[View Listings](#)
[Page Bottom](#)

Metal-clad Cable

Guide Information for Electrical Equipment for Use in Ordinary Locations

GENERAL

This category covers Type MC metal-clad cable. The cable is rated for use up to 2000 V, and certified in sizes 18 AWG through 2000 kcmil for copper, 12 AWG through 2000 kcmil for aluminum or copper-clad aluminum, and employs thermoset or thermoplastic insulated conductors. It is intended for installation in accordance with Article 330 of ANSI/NFPA 70, "National Electrical Code" (NEC).

The cable consists of one or more insulated circuit conductors, a grounding path (grounding conductor, metal sheath, or combination thereof) as described below, one or more optional optical fiber members, and an overall metal sheath. The metal sheath is an interlocked metal tape, a corrugated metal tube, or a smooth metal tube. The metal sheath of single-conductor cable is nonferrous. A nonmetallic jacket may be provided under and/or over the metal sheath. Cable with metal armor, rated 2400 to 35,000 V is covered under Medium-voltage Power Cable ([PITY](#)) and is marked "Type MV or MC."

Cable with interlocked armor that has been determined to be suitable for use as a grounding means has interlocked aluminum or steel armor in direct contact with a single, full-sized, bare aluminum grounding/bonding conductor. This cable is marked to indicate that the armor/grounding conductor combination is suitable for ground. The equipment grounding conductor required within all other cable with interlocked armor may be insulated or bare, may be sectioned, and is located in the cable core but not in contact with the armor. Any additional grounding conductors of either design have green insulation. One insulated grounding conductor may be unmarked, one other may have only a yellow stripe and the balance have surface markings that indicate they are additional equipment grounding conductors or isolated grounding conductors.

The sheath of the smooth or corrugated tube Type MC cable or a combination of the sheath and a supplemental bare or unstriped green insulated conductor is suitable for use as the ground path required for equipment grounding. The supplemental grounding conductor may be sectioned. When sectioned, all sections are identical. Each additional green insulated grounding conductor has either a yellow stripe or a surface marking or both to indicate that it is an additional equipment or isolated grounding conductor. Additional grounding conductors, however marked, are not smaller than the required grounding conductor.

PRODUCT MARKINGS

Information regarding temperature rating, voltage rating, cable and conductor Type and AWG size is shown either on a marker tape under the armor or on the surface of a nonmetallic jacket, if used.

Copper-clad aluminum conductors are surface printed "AL (CU-CLAD)" or "Cu-clad Al." Aluminum conductors are surface printed "AL."

Cable employing compact-stranded copper conductors is so identified directly following the conductor size, wherever it appears (surface, tag, carton or reel), by "compact copper." The abbreviations "CMPCT" and "CU" may be used for compact and copper, respectively.

Tags, reels and cartons for products employing compact-stranded copper conductors have the marking: "Terminate with connectors identified for use with compact-stranded copper conductors."

For termination information, see Electrical Equipment for Use in Ordinary Locations ([AALZ](#)).

Cable suitable for use in cable trays, direct sunlight or direct burial application is so marked. Cable marked for direct burial is also considered acceptable for encasement in concrete.

Cable marked "Oil Resistant I" (or "Oil Res I") is suitable for exposure to mineral oil at 60°C. Cable suitable for exposure to mineral oil at 75°C is marked "Oil Resistant II" (or "Oil Res II").

Cable containing one or more optical fiber members is marked "MC-OF."

Cable with a nonmetallic outer jacket that complies with the Limited Smoke Test requirements specified in [UL 1685](#), "Vertical-Tray Fire-Propagation and Smoke-Release Test for Electrical and Optical-Fiber Cables," and all unjacketed metal-clad cable may be marked with the suffix "-LS."

Cable with an interlocked armor that is intended as a ground path is marked "armor is grounding path component," and is provided with installation instructions.

Cable intended for use in hazardous (classified) locations, Class I, Division 1, Groups A, B, C and D; Class II, Division 1, Groups E, F and G; Class I, Zone 1, Groups IIA, IIB and IIC in accordance with the NEC, is marked "MC-HL." See Cable for Use in Hazardous Locations ([PJPP](#)) for Certification Mark requirements for cable marked "MC-HL."

PRODUCT IDENTITY

One of the following product identities may appear on the product:

Metal-clad Aluminum Cable (for metal-clad cable that contains aluminum conductors)

Metal-clad Cable (for metal-clad cable that contains copper or copper-clad aluminum conductors)

ADDITIONAL INFORMATION

For additional information, see Electrical Equipment for Use in Ordinary Locations ([AALZ](#)).

REQUIREMENTS

The basic standard used to investigate products in this category is [ANSI/UL 1569](#), "Metal-Clad Cables."

Cable marked "MC-HL" has been additionally investigated to [ANSI/UL 2225](#), "Cables and Cable Fittings for Use in Hazardous (Classified) Locations."

UL MARK

The Certification Mark of UL on the attached tag, reel, or on the smallest unit container in which the product is packaged, with or without the UL symbol on the product, is the only method provided by UL to identify products manufactured under its Certification and Follow-Up Service. The [Certification Mark](#) for these products includes the UL symbol, the words "CERTIFIED" and "SAFETY," the geographic identifier(s), and a file number.

Alternate UL Mark

The Listing Mark of UL on the attached tag, the reel, or the smallest unit container in which the product is packaged, with or without the UL symbol on the product, is the only method provided by UL to identify products manufactured under its Listing and Follow-Up Service. The Listing Mark for these products includes the UL symbol (as illustrated in the Introduction of this Directory) together with the word "LISTED," a control number, and the product name as appropriate: Metal-clad cable that contains copper or copper-clad aluminum conductors has the product name "Metal-clad Cable"; metal-clad cable that contains aluminum conductors has the product name "Metal-clad Aluminum Cable."

UL, in performing its functions in accordance with its objectives, does not assume or undertake to discharge any responsibility of the manufacturer or any other party. UL shall not incur any obligation or liability for any loss, expense or damages, including incidental or consequential damages, arising out of or in connection with the use, interpretation of, or reliance upon this Guide Information.

Last Updated on 2013-05-16

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2013 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2013 UL LLC".

Home | My Account | My Cart | Total Price Details

Username

Password

[Register Now](#)

[Forgot Password?](#)




Keyword Search



Southwire Product Catalog ARMORLITE® Type MC

ARMORLITE® Type MC

- Residential
- Commercial
- Mining
- Industrial
- Transmission
- Substation
- Distribution
- Renewables
- OEM
- SCR Technologies
- Canada
- América Latina



Lightweight Aluminum Interlocked Armor
 600 Volt
 Copper Power Conductors
 THHN/THWN Insulated Singles
 Green Insulated Grounding Conductor
 Sizes 14 AWG through 2 AWG
 Rated VW-1

APPLICATIONS

Branch, feeder and service power distribution in commercial, industrial, institutional, and multi-residential buildings
 Power, lighting, control, and signal circuits
 Fished or embedded in plaster
 Concealed or exposed installations.
 Environmental air-handling spaces per NEC 300.22(C)
 Places of Assembly per NEC 518.4 and theaters per NEC 520.5
 As aerial cable on a messenger
 Installation in cable tray and approved raceways
 Under raised floors for information technology equipment conductors and cables per NEC 645.5(D) & 645.5(D)(2)
 Class I Div. 2, Class II Div. 2, & Class III Div. 1 Hazardous Locations

Product Specifications




MADE IN THE USA

RELATED PRODUCTS

- ALFLEX® Type RWA
- ALFLEX® Type SWA
- ARMORLITE® Type AC
- DATA-FLEX®
- DURACLAD® Type AC
- DURACLAD® Type MC
- GALFLEX® Type RWS
- HCF MCAP® Type MC
- Lite-Whip®
- MCAP® Type MC
- MC Whip™
- RED ALERT® Plenum Type MC-FPLP
- SLINKY-FLEX® Type SF
- TITAN® Type CB
- TITAN® Type EF
- TITAN® Type HC
- TITAN® Type OR
- TITAN® Type UL
- ULTRATITE® Type NM
- ULTRATITE® Type NMEF
- ULTRATITE® Type NMHC
- ULTRATITE® Type NMOR

Ultra-Whip®

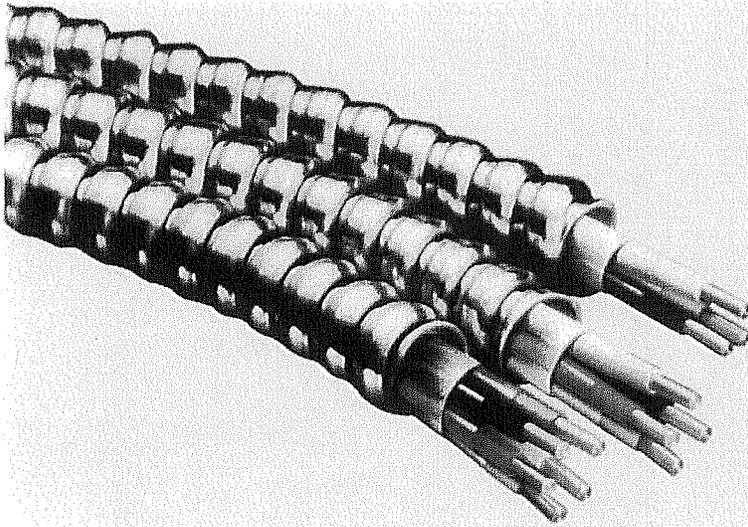

RECEIPT

ELPASO
ELPASO
2 CIVIC CENTER PLAZA
City of El Paso

Application: BCNN12-00009
Application Type: Building/Commercial/New/NA
Address: 140 W CASTELLANO, EL PASO, TX 79912

Receipt No.	Ref Number	Amount Paid	Payment Date	Cashier ID	Received	Comments
Credit Card		\$550.69	08/13/2013	CONEJODE	In Person	

Owner Info.:
140 CASTELLANO DR
EL PASO, TX 79912

Work Description: New Apartment Building